
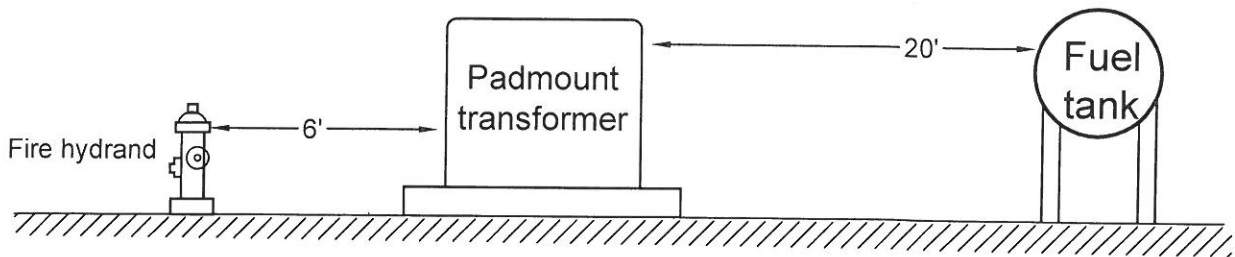
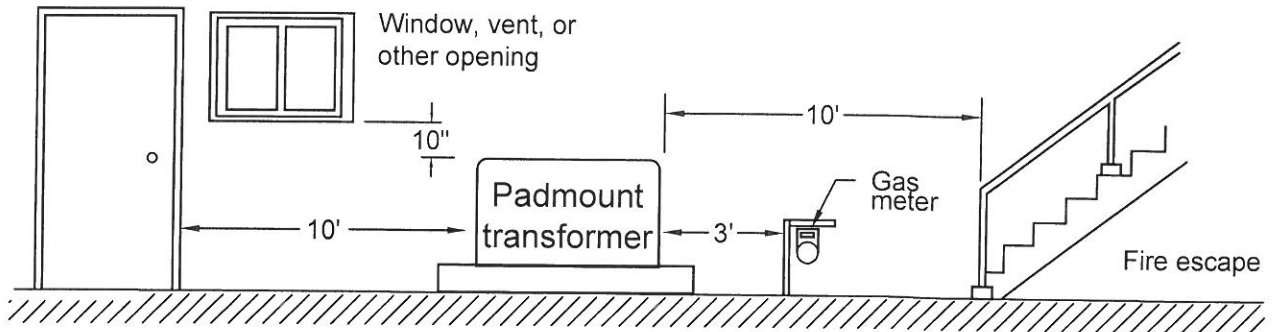
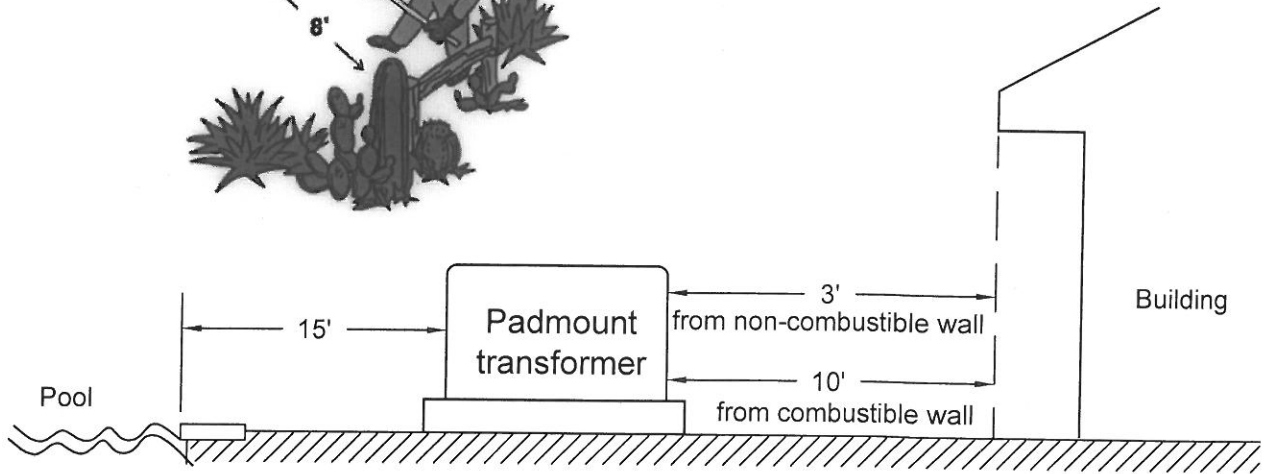


Note:

- Keep shrubs, landscape material and structures 8 feet away from the doors and 18 inches away from the sides of transformer

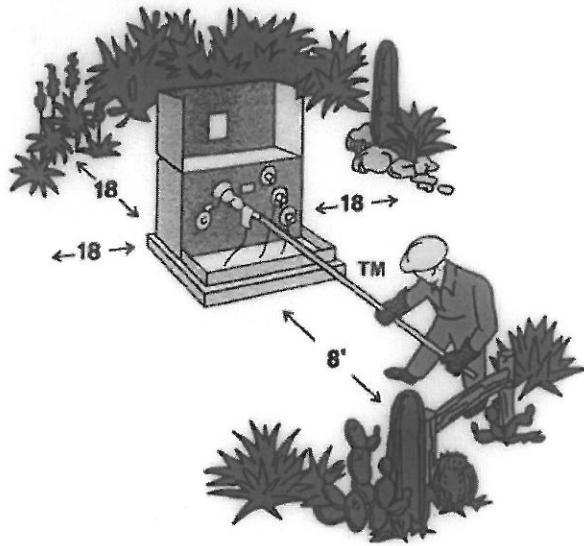

Source: Safety Clearances Around Padmount Transformers, p. 58-59, Distribution Transformer Handbook, 1st Ed., October 2001

ELECTRIC STANDARD



DRAWN: HV
DATE: 2-5-13
SCALE: NTS

**CLEARANCE REQUIREMENTS
 AROUND PAD MOUNT TRANSFORMER**

DWG. NO.
ED26
SHEET
1 OF 1

APPROVED: *Juen K. Chong* 2-26-13
DATE